

## Transmission Line Permit and Licence 25074-D05-2020

Appendix 1 to Decision 25074-D02-2020

November 16, 2020

Windrise Wind Energy Inc.  
New Transmission Line 497L

Proceeding 25074  
Application 25074-A002

Windrise Wind Energy Inc. (Windrise), by Application 25074-A002, registered on November 29, 2019, applied to the Alberta Utilities Commission for approval to construct and operate a 138-kilovolt (kV) transmission line, designated as 497L, from Windrise's Windrise 1063S Substation to AltaLink Management Ltd.'s Windy Flats 138S Substation in the Ardenville area.

The Commission, pursuant to sections 14, 15 and 19 of the *Hydro and Electric Energy Act*, approved the application in Decision 25074-D02-2020<sup>1</sup> and granted to Windrise a permit to construct and a licence to operate the transmission line, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act*, any regulations made under the acts, any orders made under the acts, the Commission rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. The route of the transmission line shall be as shown on Appendix A and as described in the application.
2. Temporary workspace areas shall be set up at the locations listed in Appendix B and as described in the application.
3. Specifications of the transmission line shall include the following:
  - a) The transmission line shall be designed, built for and operated at a nominal voltage of 138 kV.
  - b) The structures shall be constructed of materials as specified in the application.
  - c) Other aspects of the transmission line shall be constructed as more particularly described in the application.
4. Windrise shall file with the Commission, within 30 days of completing the transmission line, the energization certificate(s) for the transmission line issued by the Alberta Electric System Operator and/or by Windrise, to confirm that the transmission line has been completed and is being operated in accordance with the provisions of this permit and licence.

<sup>1</sup> Decision 25074-D02-2020: Windrise Wind Energy Inc. – Transmission Line 497L and Interconnection, Proceeding 25074, Applications 25074-A002 and 25074-A004, November 16, 2020.

5. Unless otherwise authorized by the Commission, the transmission line shall be completed by December 1, 2021, or a later date of June 1, 2022 subject to Windrise filing an approval by the Alberta Electric System Operator of a change proposal for the later in-service date.

The Commission may cancel or suspend this permit and licence, in whole or in part, in accordance with Section 41 of the *Hydro and Electric Energy Act* or may review this permit and licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with Section 10 of the *Alberta Utilities Commission Act*.


The Commission may, within 30 days of the date of this permit and licence and without notice, correct typographical, spelling and calculation errors and other similar types of errors and post the corrected permit and licence on its website.

**Alberta Utilities Commission**

*(original signed by)*

Kristi Sebalj  
Panel Chair

# Appendix A

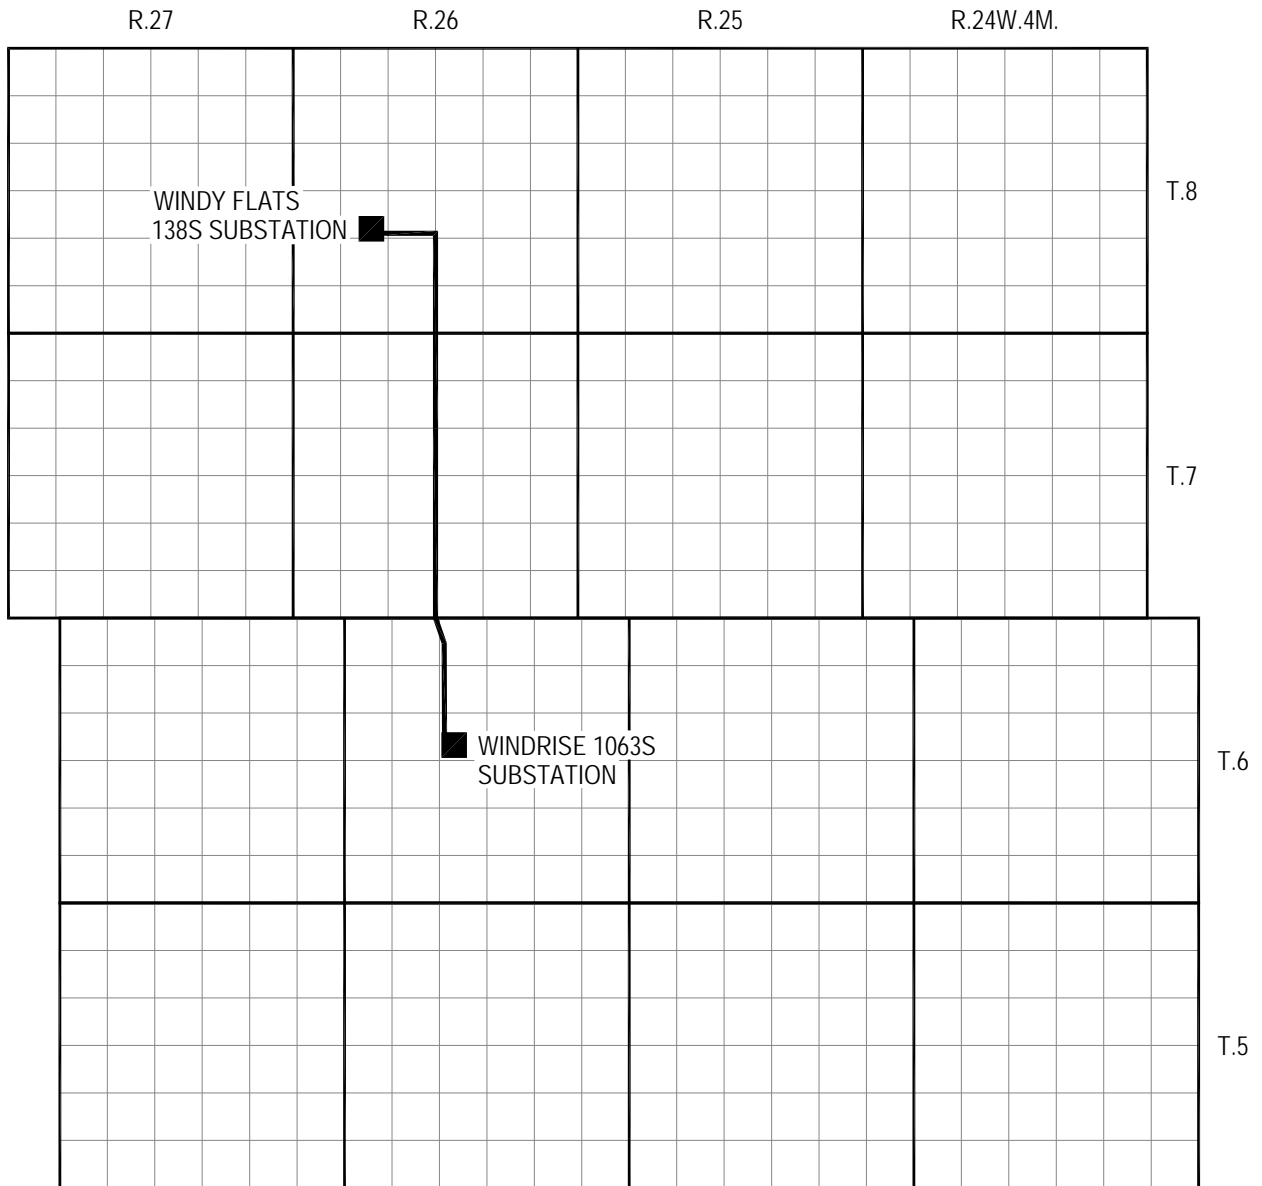

## ARDEVILLE AREA

APPENDIX A PERMIT AND LICENCE 25074-D05-2020



### LEGEND

— WINDRISE WIND ENERGY INC. 138-KV TRANSMISSION LINE 497L

## Appendix B – Temporary workspace areas

<b>Type</b>	<b>Land Location (Section-Township-Range-Meridian)</b>
Workspace	SE 20-06-26-4
Workspace	NW 21-06-26-4
Workspace	NE 20-06-26-4
Workspace	SE 32-06-26-4
Workspace	NE 32-06-26-4
Workspace	NE 21-07-26-4
Workspace	NE 09-08-26-4
Workspace	NW 09-08-26-4
Workspace	NE 08-08-26-4