

Transmission Line Permit and Licence 26327-D01-2021

AltaLink Management Ltd. Transmission Line 901L Alteration	February 25, 2021 Proceeding 26327 Application 26327-A001
---	---

AltaLink Management Ltd., pursuant to Permit and Licence U2012-653,¹ is the operator of the 240-kilovolt (kV) Transmission Line 901L from Red Deer 63S Substation to Janet 74S Substation, in the Red Deer – Janet area. By Application 26327-A001, registered on February 18, 2021, AltaLink informed the Alberta Utilities Commission of an emergency structure replacement to Transmission Line 901L and requested an updated permit and licence. AltaLink stated that it replaced one existing steel lattice structure, 901L210, with one steel H-frame structure because the existing structure was damaged beyond repair and needed a replacement immediately. Due to the emergency nature of the alteration, the new structure was installed and operational on October 16, 2020.

AltaLink has provided information respecting the need, nature, extent, project area and timing of the work, in accordance with the requirements of Section 12 of the *Hydro and Electric Energy Regulation*. Based upon the information provided, the Commission is satisfied that the work was of a minor nature, no person was directly and adversely affected by the work and no significant adverse environmental impact was caused by the alteration, thereby meeting the requirements of Section 11 of the *Hydro and Electric Energy Regulation*.

The Commission, pursuant to sections 14, 15, 19 and 21 of the *Hydro and Electric Energy Act*, approves the application and grants to AltaLink a permit to alter and a licence to operate the transmission line, subject to the provisions of the *Hydro and Electric Energy Act* and the *Alberta Utilities Commission Act*, any regulations made under the acts, any orders made under the acts, the Commission rules made pursuant to the *Alberta Utilities Commission Act*, and the following terms and conditions:

1. The route of the transmission line shall be as shown on Appendix A and as described in the application and previous applications.
2. Specifications of the transmission line shall include the following:
 - (a) The transmission line shall be designed, built for and operated at a nominal voltage of 240 kV.

¹ Transmission Line Permit and Licence U2012-653, Proceeding 1045, Application 1607067, December 20, 2012.

- (b) The structures shall be constructed of materials as specified in the application and other previous approvals pertaining to the transmission line.
- (c) Other aspects of the transmission line shall be as more particularly described in the application and other previous approvals pertaining to the transmission line.

Permit and Licence U2012-653 is rescinded.


The Commission may cancel or suspend this permit and licence, in whole or in part, in accordance with Section 41 of the *Hydro and Electric Energy Act* or may review this permit and licence, in whole or in part, upon its own motion or upon an application by an interested party, in accordance with Section 10 of the *Alberta Utilities Commission Act*.

The Commission may, within 30 days of the date of this permit and licence and without notice, correct typographical, spelling and calculation errors and other similar types of errors and post the corrected permit and licence on its website.

Alberta Utilities Commission

(original signed by)

Vera Slawinski
Commission Member

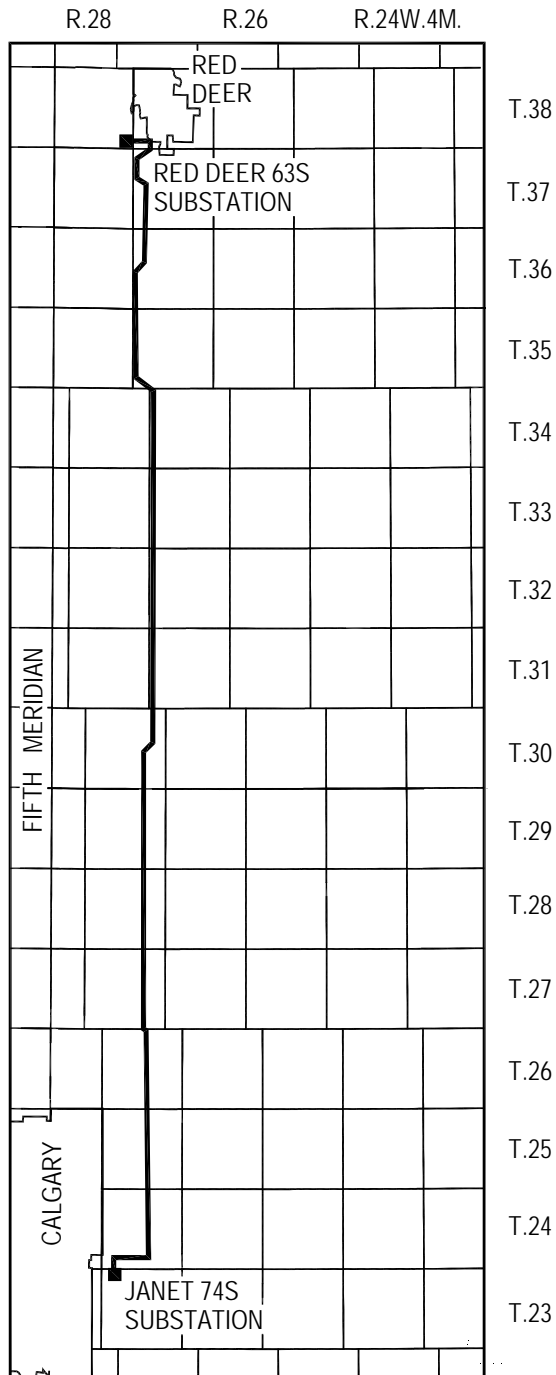

RED DEER - JANET AREA

APPENDIX A PERMIT AND LICENCE 26327-D01-2021
 PREVIOUS PERMIT AND LICENCE U2012-653

LEGEND

 ALTALINK MANAGEMENT LTD. 240-kV TRANSMISSION LINE 901L

